
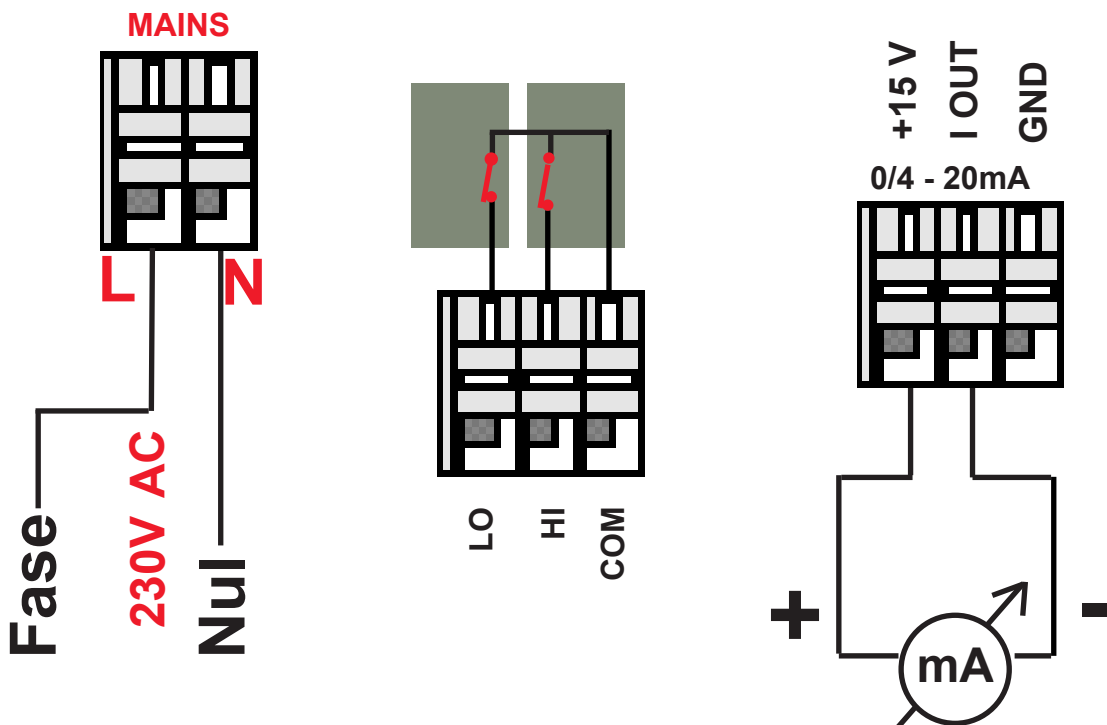


# Installation of OC2016

The OS2014 sensor is fitted top down in the flue gas channel wall. In small channels a M18 x 1.5 mm threaded hole is prepared. In larger flue channels a guide tube is used. The OC2016 is mounted at eye-level immediately below or near the probe.

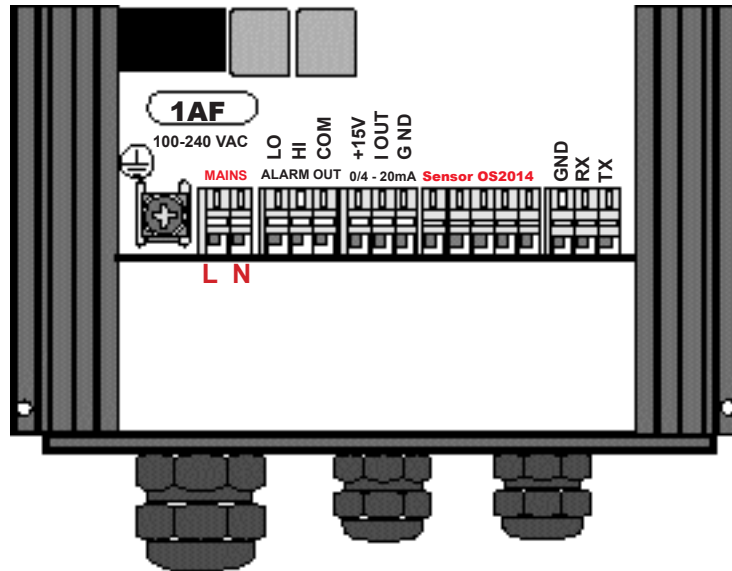

## IMPORTANT!

The unit is tested to obtain a specification as having "Approved Safety", this means that all cable connections must be done accordingly. Therefore, please use the cable clamps to secure the wires of the cables and leave no excess cable length between clamps and terminals and use terminal-tubes/ core-protectors if using multicore wires. Supply wires to OC2016 must be disconnectable by a separate switch in the panel.